

Mycoplasma Testing Results
(MycoStrip – Invivo Lot: 10619-46-05)
Date: 3rd March 2026


<u>Location</u>	<u>Band (C/and or T)</u>	<u>Results</u>	<u>Pass/Fail</u>
Carboy 1	C	Negative	Pass
S8 Stream	C	Negative	Pass
S8 Tank 1	C	Negative	Pass
S8 Tank 2	C	Negative	Pass
S8 Tank 3	C	Negative	Pass
S8 Tank 4	C	Negative	Pass
S8 Tank 5	C	Negative	Pass
CS Sheath Tank 1	C	Negative	Pass
CS Stream	C	Negative	Pass
CS Tank 2	C	Negative	Pass
CS Tank 3	C	Negative	Pass
Positive Control	C and T	Positive	Pass

Interpretation:

C Band: Mycoplasma Not Detected

T Band: Mycoplasma Detected

Results:

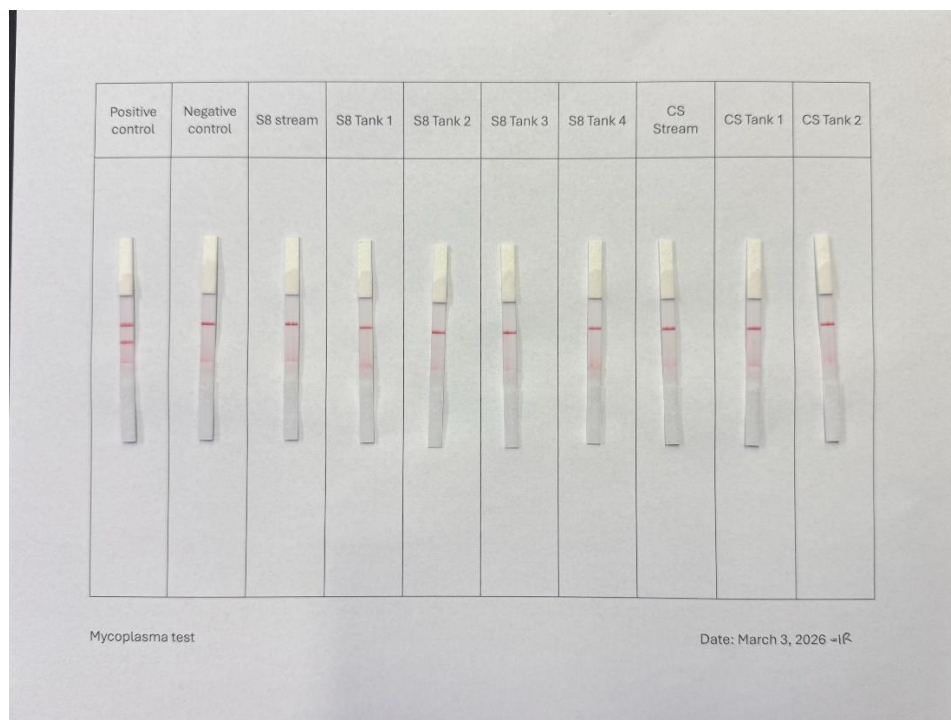

Remarks: None